


NOTE:

Services installed in concrete areas, not subject to vehicle traffic, a Ford Type A32, or approved equal, lid and ring shall be used. Areas subject to vehicle traffic, a Ford Type A32HH, or approved equal, lid and ring shall be used.

NOTE:

Services to be removed & abandoned are to be disconnected at corporation stop. Cap corporation stop if required to prevent leaks or replace stop.

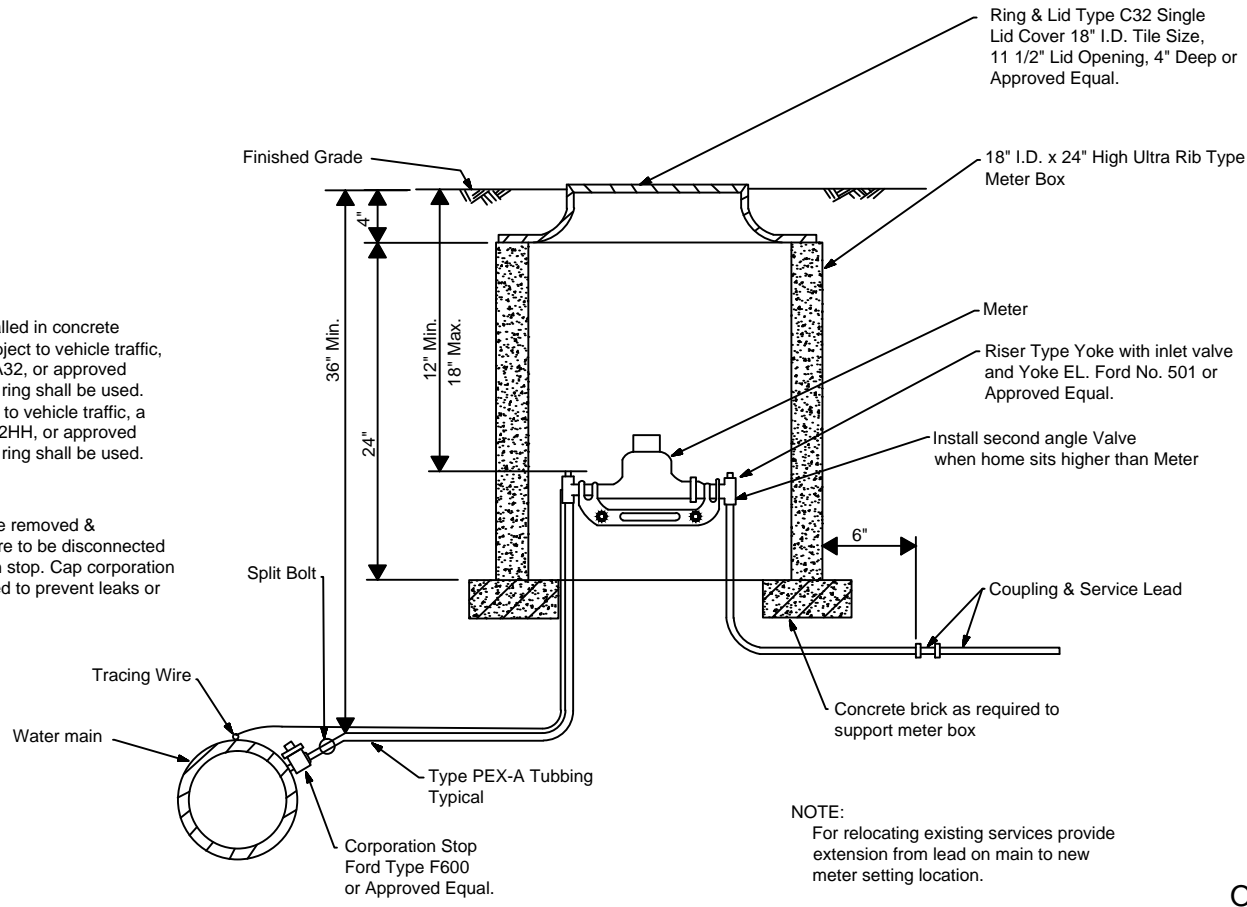


PVC Mains-Use single band brass saddle
Ford Type 101 BS or equal.

NOTE:

For relocating existing services provide extension from lead on main to new meter setting location.

ONLY FOR D.I. PIPE

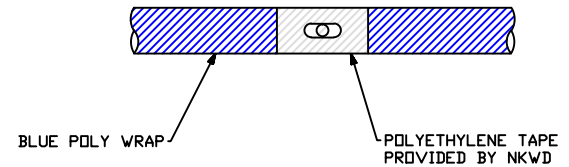

REVISION	BY	DATE

N. KY. WATER DISTRICT
5/8" & 1" METER SETTING
PEX-A SERVICE LINE

DRAWN BY:
SAR

APPROVED:
RH

DATE:
8/5/2014

STANDARD
DRAWING NO:
107-A