


PLAN

3'-0" Ø CONCRETE PAD, 5" THICK

VALVE BOX ASSEMBLY

STREET R/W LINE

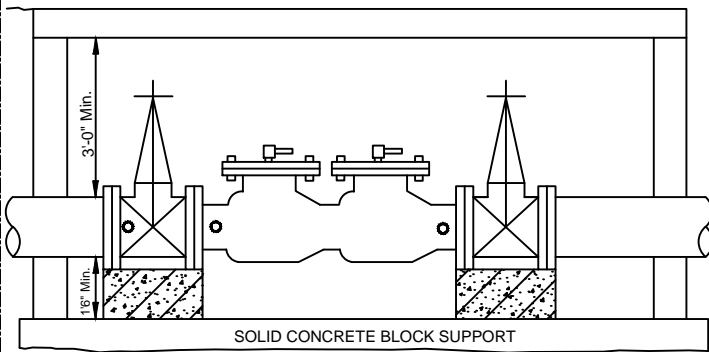

ELEVATION

SOLID CONCRETE BLOCK SUPPORT

DRAWING NOTES

- ① Piping Class 52 With Flanged Ends Within Pits.
- ② An approved Double Check Valve Assembly shall be required on Fire Lines by the following governing bodies: Kentucky Public Service Commission, Kentucky Division of Water, and Kentucky Division of Plumbing.
- ③ Plain End Pipe By Plain End Pipe With Uniflange Coupler In Pit

GENERAL NOTES

1. SEE DRAWING NO.202 FOR PIT CONSTRUCTION DETAILS
2. SEE DRAWING NO. 201 FOR PIT MATERIALS SPECIFICATIONS
3. SEE DRAWING NO. 203 FOR PIT SPECIFICATIONS
4. ANY PUMPER CONNECTION SHALL BE INSTALLED DOWNSTREAM OF OUTLET VALVE & BACK FLOW DEVICE.
5. ANY POST INDICATOR SHALL BE TYPE THAT WILL ATTACH TO WHEEL OPERATOR AND ALLOW OPERATION OF VALVE WITHIN PIT.
6. SHADED AREAS INDICATE WHAT THE PROPERTY OWNER WILL MAINTAIN AFTER THE WARRANT PERIOD EXPIRES.

REVISION	BY DATE	
	BY	DATE
N. KY. WATER DISTRICT		
DOUBLE CHECK VALVE		
SETTING FOR FIRE SYSTEM ONLY		
DRAWN BY: SAR		
APPROVED: <i>RH</i>		
DATE: 8/5/2014		
STANDARD DRAWING NO: 204		