


PLAN

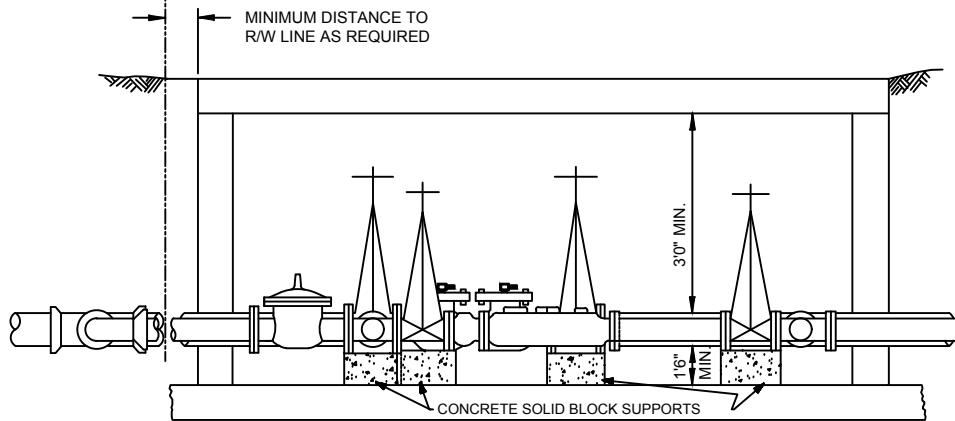

ELEVATION

DRAWING NOTES

- ① REFER TO DRAWING NO. 204 FOR DETAILS OF FIRE BRANCH PIPING.
- ② 2.5" OR LARGER DOMESTIC COMPOUND METER REFER TO DRAWING NO.205 FOR DETAILS OF DOMESTIC SERVICE LINE PIPING.
- ③ FLANGED COUPLING ADAPTER OVER PLAIN END PIPE 1'0" LONG MINIMUM. (OPTIONAL)
- ④ PROVIDE CONCRETE THRUST BLOCKS (SEE DRAWING NO. 104) OR OTHER APPROVED MEANS AS REQUIRED TO RESTRAIN JOINTS.
- ⑤ STRAINER
- ⑥ CLA-VAL 90-01 or 690-01 (if system pressure exceeds 110 psi)

GENERAL NOTES

- 1. SEE DRAWING NO. 202 FOR PIT CONSTRUCTION DETAIL.
- 2. SEE DRAWING NO. 201 FOR PIT MATERIALS SPECIFICATIONS.
- 3. SEE DRAWING NO. 203 FOR PIPING SPECIFICATIONS.
- 4. ANY POST INDICATOR SHALL BE TYPE THAT WILL ATTACH TO WHEEL OPERATOR AND ALLOW OPERATION OF VALVE WITHIN THE PIT.
- 5. ANY PUMPER CONNECTION SHALL BE INSTALLED DOWNSTREAM OF FIRE BRANCH OUTLET VALVE AND ANY BACK FLOW DEVICE.
- 6. SHADED AREA INDICATES WHAT THE PROPERTY OWNER WILL MAINTAIN AFTER THE WARRENTY PERIOD EXPIRES.
- 7. An approved Approved Back flow Prevention Assembly shall be required on Fire Lines by the following governing bodies: Kentucky Public Service Commission, Kentucky Division of Water, and Kentucky Division of Plumbing.

REVISION	BY DATE	
N. KY. WATER DISTRICT		
DUAL SERVICE BRANCH		
SETTING W/3" & LARGER METER		
DRAWN BY: SAR		
APPROVED: <i>[Signature]</i>		
DATE: 2/1/2021		
STANDARD DRAWING NO: 211		