



STREET WITH SIDEWALK

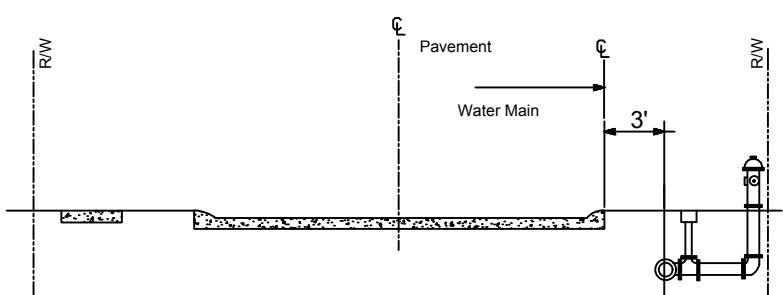

STREET WITHOUT SIDEWALK

DRAWING NOTES

- ① Mechanical Joint Anchoring Tee-Clow No.F-1217 or equal as approved.
- ② Mechanical Joint Gate Valve
- ③ Mechanical Joint Anchoring Pipe Clow No.F-1216 or Approved equal Length as required.

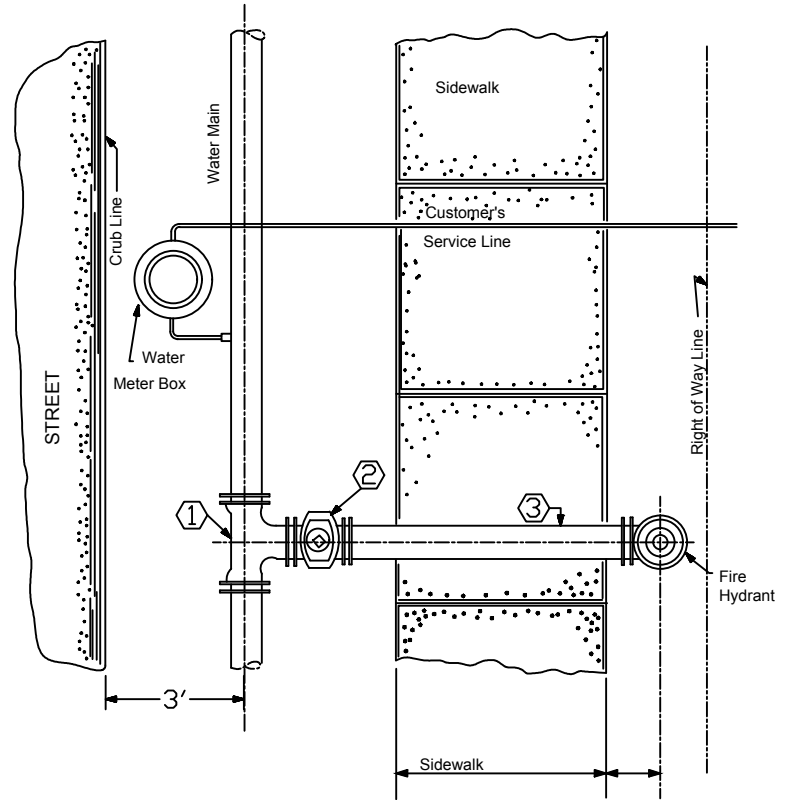

All ductile iron pipe, fittings and valves shall be wrapped with polyethelene encasement in accordance with specifications.

REVISION	BY	DATE
1.	MPS	1/15/21
	MPS	02/23

The 30' under 20mm. not for intersect.
Detail temp. destandard blocking.

N. KY. WATER DISTRICT

WATER MAINS TERMINATIONS

DRAWN BY: SAR

APPROVED: *[Signature]*

DATE: 2/1/2021

STANDARD DRAWING NO: 102