

NOTE:
 Services installed in concrete areas, not subject to vehicle traffic, a Ford Type A32, or approved equal, lid and ring shall be used. Areas subject to vehicle traffic, a Ford Type A32HH, or approved equal, lid and ring shall be used.


NOTE:
 Services to be removed & abandoned are to be disconnected at corporation stop. Cap corporation stop if required to prevent leaks or replace stop.

NOTE:
 When the pressure exceeds 110 psi on a new service, a double yoke setter shall be used. This setting will contain a pressure reducer and the meter.

NOTE:
 For relocating existing services provide extension from lead on main to new meter setting location.

PVC Mains-Use single band brass saddle Ford Type 101 BS or equal.

** Taps on mains which utilizes a cathodic protection system shall require an isolation corporation stop

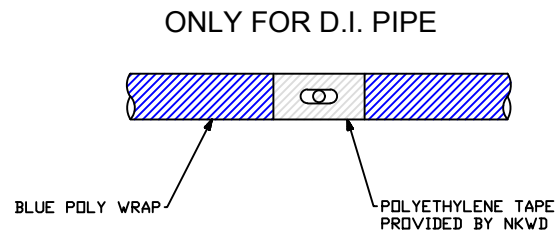

REVISION	BY	DATE
N. KY. WATER DISTRICT		
5/8" & 1" METER SETTING PEX-A SERVICE LINE		
DRAWN BY: SAR		
APPROVED: <i>[Signature]</i>		
DATE: 2/1/2021		
STANDARD DRAWING NO: 107-A		