
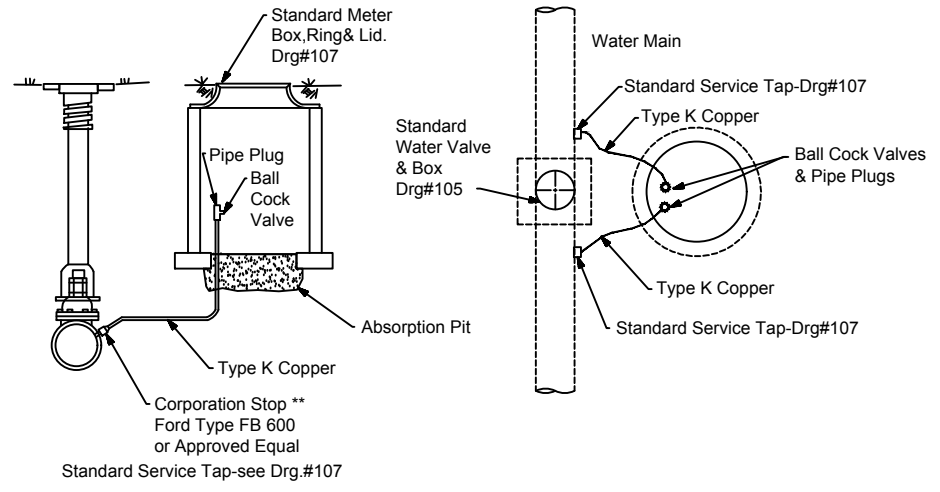
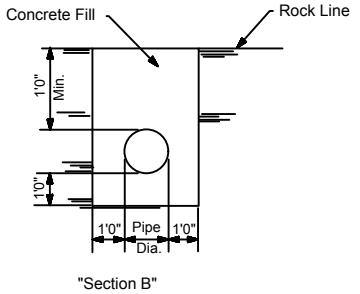
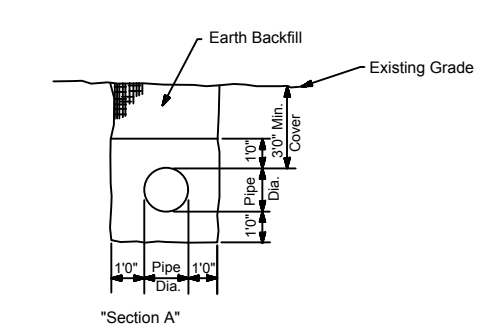


NOTE: Isolating Valve same as other side crossing.
No test taps on this side.

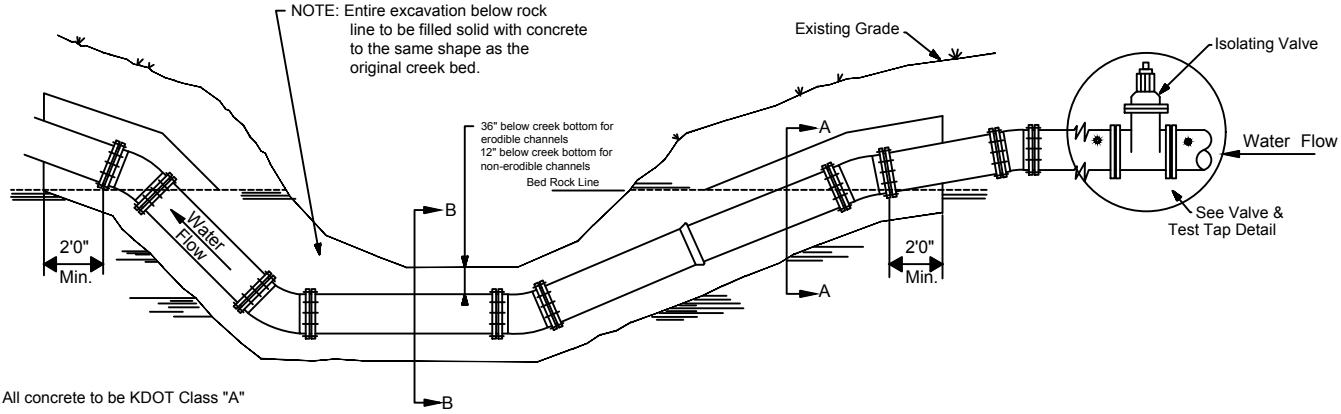

VALVE & TEST TAP DETAIL

Valve shall be installed in areas not subject to flooding
No services will be tapped between the isolating valve on the creek crossings.

** Taps on mains which utilizes a cathodic protection system shall require an isolation corporation stop

REVISION	BY	DATE

N. KY. WATER DISTRICT
CONCRETE ENCASEMENT AT
CREEK CROSSING

DRAWN BY:
SAR

APPROVED:
[Signature]

DATE:
2/1/2021

STANDARD DRAWING NO:
110